


ProSTUD® 30 mil Head-of-Wall (HOW) Composite Limiting Heights
w/ 30mil 2-1/2" Leg MaxTRAK®

5/8" Type X Gypsum Board

Width	Stud Member	Yield Strength	Spacing (in) o.c.	5psf			7.5psf			10psf		
				L/120	L/240	L/360	L/120	L/240	L/360	L/120	L/240	L/360
2-1/2"	ProSTUD 30 mil 250PDS125-30	33 ksi	12	17'-10"	14'-10"	13'-0"	15'-7"	13'-0"	11'-4"	14'-2"	11'-10"	10'-4"
			16	16'-7"	13'-10"	12'-1"	14'-6"	12'-1"	10'-6"	13'-2"	11'-0"	9'-5"
			24	14'-10"	12'-4"	10'-9"	13'-0"	10'-9"	9'-2"	11'-9"	9'-8"	8'-1"
3-5/8"	ProSTUD 30 mil 362PDS125-30	33 ksi	12	24'-0"	19'-8"	17'-2"	21'-0"	17'-2"	15'-0"	19'-1"	15'-7"	13'-8"
			16	22'-4"	18'-4"	16'-1"	19'-6"	16'-1"	14'-0"	17'-9"	14'-7"	12'-8"
			24	19'-11"	16'-2"	14'-2"	17'-5"	14'-2"	12'-3"	15'-10"	12'-10"	11'-0"
4"	ProSTUD 30 mil 400PDS125-30	33 ksi	12	26'-0"	20'-8"	18'-1"	22'-9"	18'-1"	15'-9"	20'-8"	16'-5"	14'-4"
			16	24'-3"	19'-3"	16'-10"	21'-2"	16'-10"	14'-8"	19'-3"	15'-3"	13'-4"
			24	21'-8"	17'-2"	15'-0"	18'-11"	15'-0"	13'-1"	17'-2"	13'-7"	11'-8"
6"	ProSTUD 30 mil 600PDS125-30	33 ksi	12	34'-2"	28'-2"	24'-9"	29'-10"	24'-7"	21'-8"	27'-1"	22'-4"	19'-8"
			16	31'-9"	26'-2"	23'-0"	27'-9"	22'-10"	20'-1"	25'-2"	20'-9"	18'-3"
			24	28'-4"	23'-1"	20'-2"	24'-9"	20'-2"	17'-7"	22'-0" f	18'-4"	—

Notes:

- Allowable HOW composite limiting heights were tested in accordance with AISI S916 and ICC-ES AC86.
- The tests were modified from the standards with the tracks fastened to the test fixture such that the wall stiffness included the track deformation.
- In accordance with current building codes and AISI design standards, the 1/3 Stress Increase for strength was not used.
- The composite limiting heights provided in the tables are based on a single layer of 5/8" Type X Gypsum Board from the following manufacturers: American, CertainTeed, Georgia Pacific, Continental, National, PABCO, and USG.
- The gypsum board must be applied full height in the vertical orientation to each stud flange and installed in accordance with ASTM C754 using minimum No. 6 Type S Drywall screws spaced as listed below:
 - Sheathing screws spaced a maximum of 16 in on-center to framing members (including bottom track) when studs spaced at 16 in or 12 in on-center.
 - Sheathing screws spaced a maximum of 12 in on-center to framing members (including bottom track) when studs spaced at 24 in on-center.
- #8 wafer head screws shall be used for attaching the stud to 30mil 2-1/2" Leg MaxTRAK (as top track) adhering to details below:
 - Stud to track connection must be installed as depicted in figure with a maximum gap of 7/8" between the web of the MaxTRAK and end of stud.
 - Slots in the MaxTRAK Legs allows for a total vertical movement of 1-1/2" (± 3/4") with screw centered in slots
 - Screws shall be placed in each flange of the stud at a minimum of 3/8" from the end of the stud
 - To permit head of wall deflection, gypsum board must not be fastened directly to the MaxTRAK
- No fasteners are required for attaching the stud to the bottom track except as detailed in ASTM C754.
- f** Adjacent to the height value indicates that flexural stress controls the allowable wall height.

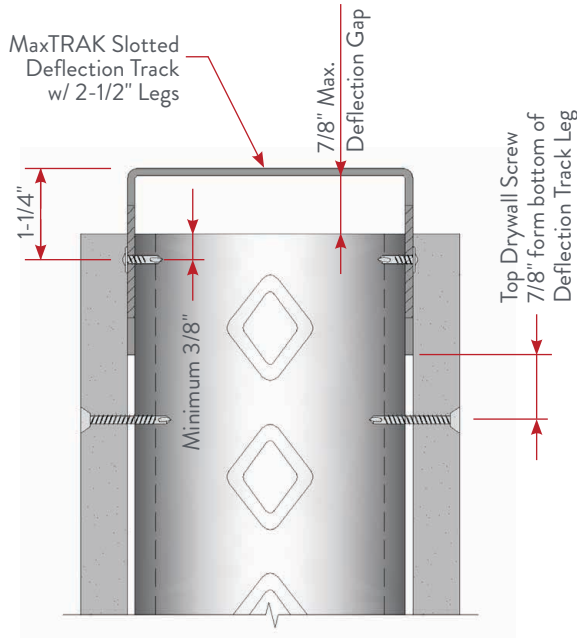

Complies with IBC 2024 • AISI S100 • AISI S220