


ProSTUD® 33mil Head-of-Wall (HOW) Composite Limiting Heights w/ 30mil 2-1/2" Leg MaxTRAK®				5/8" Type X Gypsum Board								
Width	Stud Member	Yield Strength	Spacing (in) o.c.	5psf			7.5psf			10psf		
				L/120	L/240	L/360	L/120	L/240	L/360	L/120	L/240	L/360
2-1/2"	ProSTUD 33 mil 250PDS125-33	33 ksi	12	18'-9"	14'-10"	13'-0"	16'-4"	13'-0"	11'-4"	14'-10"	11'-10"	10'-4"
			16	17'-5"	13'-10"	12'-1"	15'-2"	12'-1"	10'-6"	13'-10"	11'-0"	9'-5"
			24	15'-6"	12'-4"	10'-9"	13'-7"	10'-9"	9'-2"	12'-4"	9'-8"	8'-1"
3-5/8"	ProSTUD 33 mil 362PDS125-33	33 ksi	12	24'-10"	19'-8"	17'-2"	21'-8"	17'-2"	15'-0"	19'-8"	15'-7"	13'-8"
			16	23'-2"	18'-4"	16'-1"	20'-3"	16'-1"	14'-0"	18'-4"	14'-7"	12'-8"
			24	20'-9"	16'-5"	14'-4"	18'-1"	14'-4"	12'-5"	16'-5"	13'-1"	11'-1"
4"	ProSTUD 33 mil 400PDS125-33	33 ksi	12	26'-0"	20'-8"	18'-1"	22'-9"	18'-1"	15'-9"	20'-8"	16'-5"	14'-4"
			16	24'-3"	19'-3"	16'-10"	21'-2"	16'-10"	14'-8"	19'-3"	15'-3"	13'-4"
			24	21'-8"	17'-2"	15'-0"	18'-11"	15'-0"	13'-1"	17'-2"	13'-8"	11'-8"
6"	ProSTUD 33 mil 600PDS125-33	33 ksi	12	34'-5"	28'-2"	24'-11"	30'-1"	24'-7"	21'-9"	27'-4"	22'-4"	19'-9"
			16	32'-1"	26'-2"	23'-2"	28'-0"	22'-11"	20'-3"	25'-5"	20'-10"	18'-5"
			24	28'-8"	23'-5"	20'-8"	25'-0"	20'-6"	18'-1"	22'-9"	18'-7"	16'-4"

Notes:

- Allowable HOW composite limiting heights were tested in accordance with AISI S916 and ICC-ES AC86.
- The tests were modified from the standards with the tracks fastened to the test fixture such that the wall stiffness included the track deformation.
- In accordance with current building codes and AISI design standards, the 1/3 Stress Increase for strength was not used.
- The composite limiting heights provided in the tables are based on a single layer of 5/8" Type X Gypsum Board from the following manufacturers: American, CertainTeed, Georgia Pacific, Continental, National, PABCO, and USG.
- The gypsum board must be applied full height in the vertical orientation to each stud flange and installed in accordance with ASTM C754 using minimum No. 6 Type S Drywall screws spaced as listed below:
 - Sheathing screws spaced a maximum of 16 in on-center to framing members (including bottom track) when studs spaced at 16 in or 12 in on-center.
 - Sheathing screws spaced a maximum of 12 in on-center to framing members (including bottom track) when studs spaced at 24 in on-center.
- #8 wafer head screws shall be used for attaching the stud to 30mil 2-1/2" Leg MaxTRAK (as top track) adhering to details below:
 - Stud to track connection must be installed as depicted in figure with a maximum gap of 7/8" between the web of the MaxTRAK and end of stud.
 - Slots in the MaxTRAK Legs allows for a total vertical movement of 1-1/2" ($\pm 3/4"$) with screw centered in slots
 - Screws shall be placed in each flange of the stud at a minimum of 3/8" from the end of the stud
 - To permit head of wall deflection, gypsum board must not be fastened directly to the MaxTRAK
- No fasteners are required for attaching the stud to the bottom track except as detailed in ASTM C754.
- f** Adjacent to the height value indicates that flexural stress controls the allowable wall height.

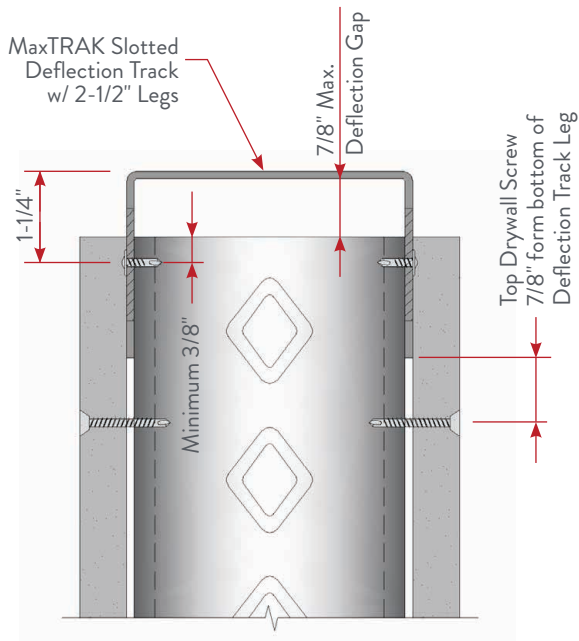

Complies with IBC 2024 • AISI S100 • AISI S220